


- GENERAL NOTES**
- House shall be minimum of 30' from well. Septic field shall be minimum of 10' from house, 25' from drainage swales, and 50' from well.
  - Well site locations shown thus: (W)
  - Perc test locations shown thus: (P)
  - Sewerage disposal areas shown thus: (S)
  - Lot is to be served by a proposed individual septic disposal system and well drilled to an approved, confined aquifer.
  - This plan was prepared without the benefit of a title report which may reveal additional conveyances, easements, rights-of-way, or building restriction lines not shown.
  - Lot recorded at PB.3 P.11, 5/25/56.
  - All construction to be done to the latest St. Mary's County Department Land Use and Growth Management Standards and Specifications in accordance with current county ordinances.
  - Contractor is responsible for contacting Miss Utility at 1-800-257-7777 at least 48 hours prior to the start of any construction.
  - There are no wells or sewerage disposal areas within 100' of the proposed well except as shown.
  - Following initial soil disturbance or redistribution, permanent or temporary stabilization shall be completed within three (3) calendar days as to the surface of all perimeter controls, dikes, swales, ditches, perimeter slopes, and all slopes greater than 3 horizontal to 1 vertical (3:1) and seven (7) days as to all other disturbed areas on the project site.
  - This plan is not to be used to establish fence lines.
  - Zoning: RNC (Residential Neighborhood Conservation) with LDA overlay zone.
  - This property appears to be in Zone X as shown on Flood Insurance Rate Map Panel No.24037C0081F dated 11/19/14.
  - Disturbed Area = 10,899 S.F.  
Total Area = 15,000 S.F.  
Forest Area Disturbed = 3,428 S.F.
  - Topography shown hereon field run by Lorenzi, Dodds & Gunnill, Inc.
  - This lot will be graded as to drain water away from the house a minimum of 6" within the first ten feet of the foundation.
  - Engineer: Lorenzi, Dodds & Gunnill, Inc.  
3475 Leonardtown Road, Suite 100  
Waldorf, Maryland 20602  
(301)645-2254 or 843-6255 c/o Tim Lessner  
c/o Bud Humbert  
P.O. Box 531  
Waldorf, Maryland 20604  
(301) 643-2583

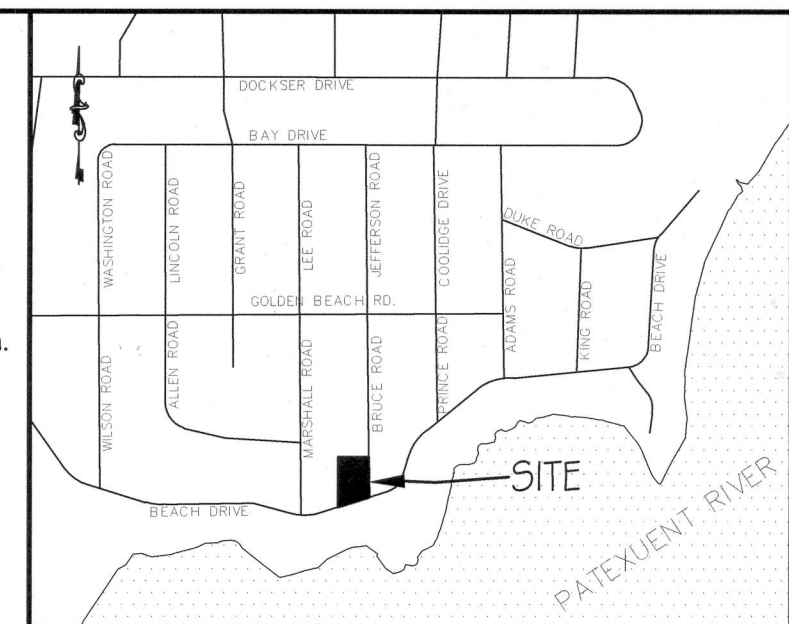

**VICINITY MAP SCALE: 1" = 1,000'**

St. Mary's County Department of Land Use and Growth Management  
Tax Map 5A, Grid 2, Parcel 56  
Tax Account: 05-019257  
Zoning: RNC (Residential Neighborhood Conservation)  
Critical Area Zoning: LDA (Limited Development Area)  
Address: 29725 Bruce Road, Mechanicsville, MD 20659  
ADC Map: 2 D9

ST. MARY'S COUNTY HEALTH DEPARTMENT  
H.D. FILE # \_\_\_\_\_  
SANITARIAN \_\_\_\_\_ DATE \_\_\_\_\_  
DIRECTOR \_\_\_\_\_ DATE \_\_\_\_\_



**ATTENTION CONTRACTOR:**  
You must verify that the soils on this site are suitable for the stormwater management devices shown on this plan BEFORE installation. If soils on this site are unsuitable, Contractor must notify LUGM by calling 301-475-4200 ext. 1560 ASAP.

**UTILITY INSTALLATION NOTE:**  
All trenches or holes created for utility installation shall be backfilled, compacted and stabilized at the end of each work day. Excavated trench material shall be placed on the high side of the trench or hole. No more trenches or holes shall be opened than can be stabilized the same day. If an area must be left unstabilized overnight, silt fence will be placed immediately downstream of all disturbed areas and installed as required or as shown on the plan.



SOILS TABLE				
SOIL MAP UNIT	SOIL DESCRIPTION	ERODIBILITY	HYDRIC	HSG
SaaA	Sassafras Sandy Loam, 0%-2% slopes	0.20	YES	B

THE CONTRACTOR SHALL NOTIFY MDE, ENFORCEMENT DIVISION, AT LEAST 48 HOURS PRIOR TO COMMENCING CLEARING OR GRADING AT: 410-537-3510 OR MDE, SEDIMENT AND STORMWATER ADMINISTRATION, 1800 WASHINGTON BLVD., BALTIMORE, MD. 21230-1708

7 Trees were cleared with project disturbance to be replaced 1:1 replacement and 15% of total area. See Critical Area Mitigation Plan - Sheet 4

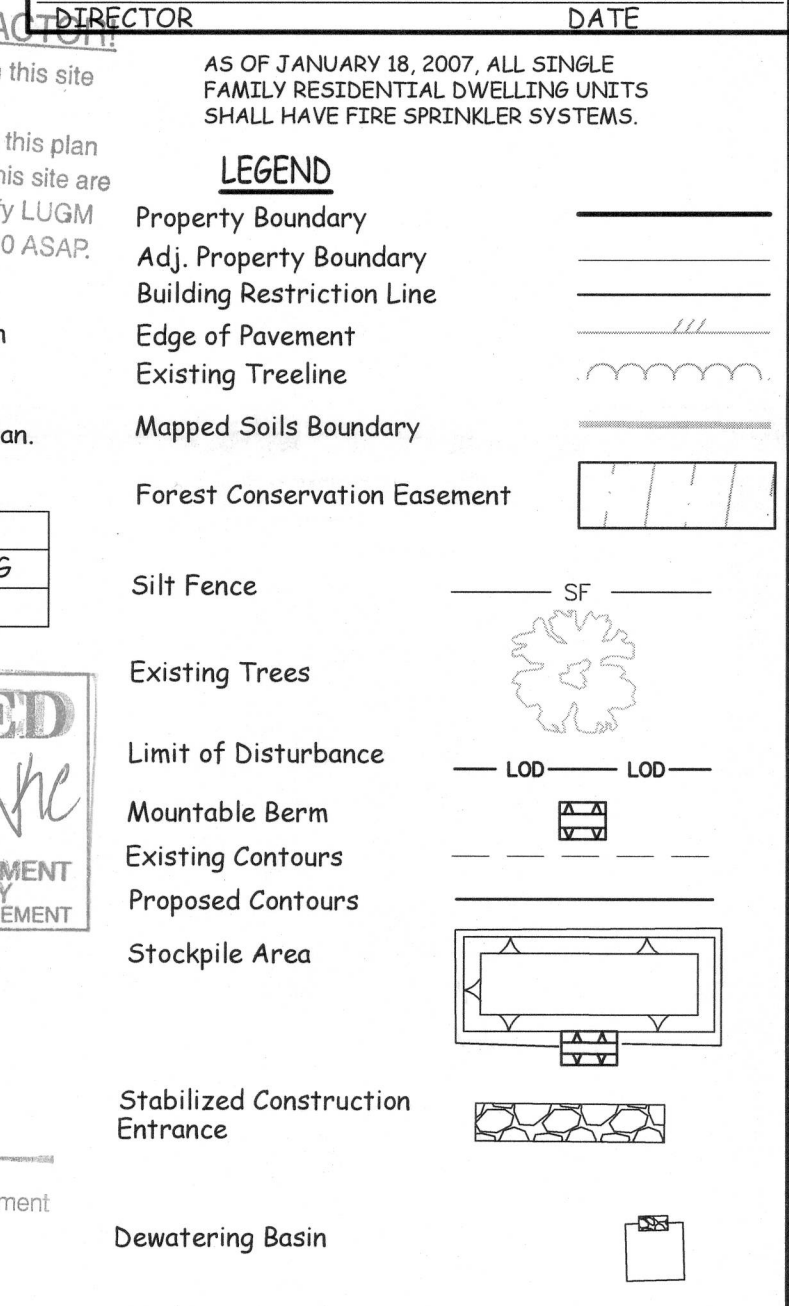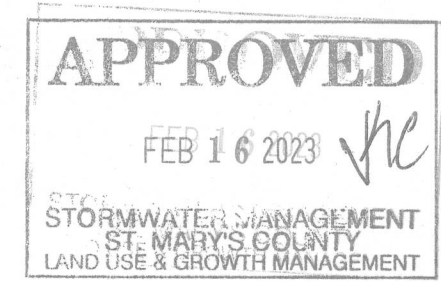

- HEALTH DEPARTMENT NOTES**
- Comprehensive Water and Sewer Statement: This lot is in compliance with the St. Mary's County Comprehensive Water and Sewer Plan.
  - All utilities shall be located outside the Health Department approved sewage easement and no other easement may hinder access to it.
  - This site plan is designed for 400 GPD flow.
  - The property owner shall maintain and operate all new and existing BAT systems for the life of the system.
  - The balance of the sewage easement as shown hereon shall remain undisturbed for future reserve site "R-1". Lot of record as of 5/26/56
  - This health department approval certifies that the lot shown hereon is in consonance with pertinent laws and regulations as of the approval date. However, this approval is subject to change in such laws and regulations. Changes in topography or site designation may void this approval. The designated perc area is the only perc area approved by the St. Mary's County Health Department for Sewage disposal purposes. The approved lot includes an area of at least 3,616 s.f. (1 and 1) for sewage disposal purposes as required by current Maryland State Health Department law. Improvements of any other nature, including but not limited to the installation of other utilities in the area may render this lot undevelopable. To determine the exact area of the lot approved for sewage disposal purposes or to establish a different area for such purposes, you MUST contact the St. Mary's County Health Department, Office of Environmental Health.
  - This lot shown hereon is to be served by an on-site sewage disposal system (O.S.D.S.). This lot is required to utilize the best available technology (BAT) for removal of nitrogen. This O.S.D.S. shall utilize a technology that is approved by the Maryland Department of the Environment.
  - There are no existing wells or sewage easements within 100 feet of the proposed wells or sewage easements, unless otherwise shown.

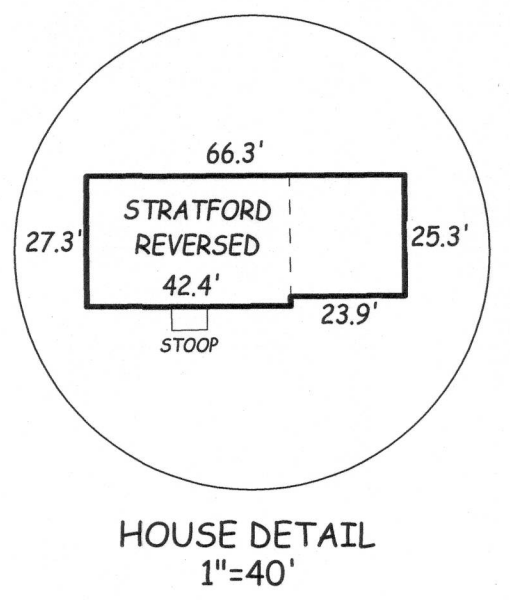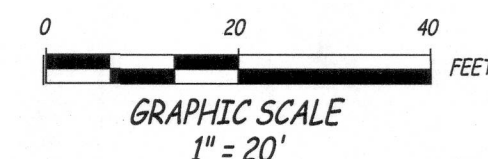

**OWNER/DEVELOPER CERTIFICATION**  
Any clearing, grading, construction or development, or all of these, will be done pursuant to this plan and that all responsible personnel involved in the construction project will have a certificate of training at a Maryland Dept. of Environment approved training program before beginning the project.

3M Asst For W.L.F. 12/9/22  
WALDORF LIONS FOUNDATION, INC. C/O JAMES CONROY DATE  
(301) 643-2583

**PROFESSIONAL CERTIFICATION**  
I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, license no. 13310, expiration date: 01-30-25.

James C. Lorenzi, P.E. 4/12/23  
Date



**DISTURBANCE NOTE**  
Disturbance (i.e. grading, tree stump removal, extensive traffic, etc.) of any portion of the sewage reserve area is not permitted and may compromise the construction of the reserve septic systems. The building permission slip issued by the health department can be voided for disturbance of the type.

SWM I#M AGREEMENT RECORDED AT:  
L. 6270 F. 62  
SEWER CATEGORY: NPS (NO PLANNED SERVICE)  
WATER CATEGORY: NPS (NO PLANNED SERVICE)  
SFDD#22-2511 TAX MAP 5A, GRID 2, PARCEL 56

<b>REVISIONS</b>		<b>Waldorf Lions Foundation, Inc</b> Golden Beach - Section 2 - Lot 681 L. 6020 F. 280 5TH ELECTION DISTRICT ~ ST. MARY'S COUNTY, MARYLAND	SCALE 1" = 20'
DRAWN: NOVEMBER 2022 NJ			
LORENZI, DODDS, AND GUNNILL, INC. 3475 LEONARDTOWN ROAD, SUITE 100 WALDORF, MARYLAND 20602 PH: (301) 645-2254 or (301) 843-6255		<b>1</b>	
		OF 4	

# STORMWATER MANAGEMENT NOTES

## SWM NON-ROOFTOP DISCONNECTION NOTES

### SWM NOTIFICATION REQUIREMENTS

THE DEVELOPER OR HIS REPRESENTATIVE SHALL ASSURE THAT INSPECTIONS ARE MADE AND APPROVALS ARE GIVEN AT

THE FOLLOWING SPECIFIED STAGES OF CONSTRUCTION:

A. INFILTRATION FACILITIES, SUCH AS, BUT NOT LIMITED TO, INFILTRATION BASINS, INFILTRATION TRENCHES AND DRYWELLS:

1. UPON COMPLETION OF PRE-EXCAVATION AND CONSTRUCTION OF TEMPORARY SEDIMENT AND EROSION CONTROL MEASURES;

2. UPON COMPLETION OF EXCAVATION;

3. DURING THE PLACEMENT OF FILTER FABRIC, OBSERVATION WELL AND BASE AGGREGATE MATERIAL;

4. DURING THE CONSTRUCTION OF CONCRETE STRUCTURES;

5. DURING THE CONSTRUCTION OF CUT-OFF TRENCH AND EMBANKMENT;

6. DURING THE PLACEMENT OF SURFACE LAYER;

7. DURING THE FINAL EXCAVATION; AND

8. UPON COMPLETION OF FINAL GRADING AND ESTABLISHMENT OF PERMANENT VEGETATIVE STABILIZATION.

B. FLOW ATTENUATION FACILITIES, SUCH AS, BUT NOT LIMITED TO, OPEN VEGETATED SWALES, DITCHES AND OPEN CHANNELS:

1. UPON COMPLETION OF PRE-EXCAVATION AND CONSTRUCTION OF TEMPORARY SEDIMENT AND EROSION CONTROL MEASURES;

2. DURING PLACEMENT AND BACKFILL OF UNDERDRAIN SYSTEMS FOR DRYWELLS;

3. DURING THE CONSTRUCTION OF CHECK DAMS, DIAPHRAGMS, OR WEIRS; AND

4. UPON COMPLETION OF FINAL GRADING AND ESTABLISHMENT OF PERMANENT VEGETATIVE STABILIZATION.

C. N/A

D. WETLANDS - AT THE STAGES SPECIFIC FOR POND CONSTRUCTION IN 10.2.C. OF THIS SECTION, DURING AND AFTER WETLAND RESERVOIR AREA PLANTING, AND DURING THE SECOND GROWING SEASON TO VERIFY A VEGETATION SURVIVAL OF AT LEAST FIFTY (50) PERCENT.

E. FILTERING SYSTEMS:

1. DURING EXCAVATION TO SUBGRADE;

2. DURING PLACEMENT AND BACKFILL OF UNDERDRAIN SYSTEMS;

3. DURING PLACEMENT OF GEOTEXTILES AND ALL FILTER MEDIA;

4. DURING CONSTRUCTION OF APPURTENANT CONVEYANCE SYSTEMS SUCH AS FLOW DIVERSION STRUCTURES, PREFILTERS AND FILTERS, INLETS, OUTLETS, ORIFICES, AND FLOW DISTRIBUTION STRUCTURES; AND

5. UPON COMPLETION OF FINAL GRADING AND ESTABLISHMENT OF PERMANENT STABILIZATION.

F. N/A

G. N/A

### SWM INSPECTION AND MAINTENANCE SCHEDULE

#### \*\* RAIN GARDENS\*\*

#### INSPECTION:

REGULAR INSPECTIONS SHALL BE MADE DURING THE FOLLOWING STAGES OF CONSTRUCTION:

\* DURING EXCAVATION TO SUBGRADE AND PLACEMENT OF PLANTING SOIL

\* UPON COMPLETION OF FINAL GRADING AND ESTABLISHMENT OF PERMANENT STABILIZATION.

#### MAINTENANCE CRITERIA:

RAIN GARDEN MAINTENANCE IS GENERALLY NO DIFFERENT THAT THAT REQUIRED OF OTHER LANDSCAPED AREAS.

THE TOP FEW INCHES OF THE PLANTING SOIL SHOULD BE REMOVED AND REPLACED WHEN WATER PONDS FOR MORE THAN 48 HOURS. SILTS AND SEDIMENT SHOULD BE REMOVED FROM THE SURFACE BED AS NEEDED.

WHERE PRACTICES ARE USED TO TREAT AREAS WITH HIGHER CONCENTRATIONS OF HEAVY METALS, MULCH SHOULD BE REPLACED ANNUALLY. OTHERWISE, THE TOP TWO TO THREE INCHES SHOULD BE REPLACED AS NECESSARY.

OCCASIONAL PRUNING AND REPLACEMENT OF DEAD VEGETATION IS NECESSARY. IF SPECIFIC PLANTS ARE NOT SURVIVING, MORE APPROPRIATE SPECIES SHOULD BE USED. WATERING MAY BE REQUIRED DURING PROLONGED DRY PERIODS.

#### CONSTRUCTION CRITERIA:

##### EROSION AND SEDIMENT CONTROL:

RAIN GARDENS SHALL NOT BE CONSTRUCTED UNTIL THE CONTRIBUTING DRAINAGE AREA IS ADEQUATELY STABILIZED.

##### PLANTING SOIL:

PLANTING SOIL SHOULD BE MIXED ON-SITE PRIOR TO INSTALLATION. IF POOR SOILS ARE ENCOUNTERED BENEATH THE RAIN GARDEN, A FOUR-INCH LAYER OF WASHED GRAVEL (1/8 TO 3/8") MAY BE USED BELOW THE PLANTING SOIL MIX.

##### LANDSCAPE INSTALLATION:

THE OPTIMUM PLANTING TIME IS DURING THE FALL. SPRING PLANTING IS ALSO ACCEPTABLE BUT MAY REQUIRE WATERING.

#### CONSTRUCTION CRITERIA:

THE FOLLOWING SHOULD BE ADDRESSED DURING CONSTRUCTION OF PROJECTS WITH NON-ROOFTOP DISCONNECTIONS:

- EROSION AND SEDIMENT CONTROL: EROSION AND SEDIMENT CONTROL PRACTICES (E.G., SEDIMENT TRAPS) SHALL NOT BE LOCATED IN AREAS DESIGNATED FOR NON-ROOFTOP DISCONNECTIONS.
- SITE DISTURBANCE: TO MINIMIZE DISTURBANCE AND COMPACTION, CONSTRUCTION VEHICLES AND EQUIPMENT SHOULD AVOID AREAS RECEIVING DISCONNECTED RUNOFF. SHOULD AREAS RECEIVING DISCONNECTED RUNOFF BECOME COMPACTED, SCARIFYING THE SURFACE OR ROTOTILLING THE SOIL TO A DEPTH OF FOUR TO SIX INCHES SHALL BE PERFORMED TO ENSURE PERMEABILITY. ADDITIONALLY, AMENDMENTS MAY BE NEEDED FOR TIGHT, CLAYEY SOILS.

#### INSPECTION:

A FINAL INSPECTION SHALL BE CONDUCTED BEFORE USE AND OCCUPANCY APPROVAL TO ENSURE THAT ADEQUATE TREATMENT AREAS AND PERMANENT STABILIZATION HAS BEEN ESTABLISHED.

#### MAINTENANCE CRITERIA:

MAINTENANCE OF AREAS RECEIVING DISCONNECTED RUNOFF IS GENERALLY NO DIFFERENT THAN THAT REQUIRED FOR OTHER LAWN OR LANDSCAPED AREAS. THE AREAS RECEIVING RUNOFF SHOULD BE PROTECTED FROM FUTURE COMPACTION (E.G., BY PLANTING TREES OR SHRUBS ALONG THE PERIMETER). IN COMMERCIAL AREAS, HIGH FOOT TRAFFIC SHOULD BE DISCOURAGED AS WELL.

## SWM ROOFTOP DISCONNECTION NOTES

#### CONSTRUCTION CRITERIA:

THE FOLLOWING SHOULD BE ADDRESSED DURING CONSTRUCTION OF PROJECTS WITH NON-ROOFTOP DISCONNECTIONS:


- EROSION AND SEDIMENT CONTROL: EROSION AND SEDIMENT CONTROL PRACTICES (E.G., SEDIMENT TRAPS) SHALL NOT BE LOCATED IN VEGETATED AREAS RECEIVING DISCONNECTED RUNOFF.
- SITE DISTURBANCE: TO MINIMIZE DISTURBANCE AND COMPACTION, CONSTRUCTION VEHICLES AND EQUIPMENT SHOULD AVOID AREAS RECEIVING DISCONNECTED RUNOFF. SHOULD AREAS RECEIVING DISCONNECTED RUNOFF BECOME COMPACTED, SCARIFYING THE SURFACE OR ROTOTILLING THE SOIL TO A DEPTH OF FOUR TO SIX INCHES SHALL BE PERFORMED TO ENSURE PERMEABILITY. ADDITIONALLY, AMENDMENTS MAY BE NEEDED FOR TIGHT, CLAYEY SOILS.
- DOWNSPOUTS MUST BE AT LEAST 10' AWAY FROM THE NEAREST IMPERVIOUS SURFACE TO PREVENT RE-CONNECTION.
- THE LENGTH OF THE "DISCONNECTION" SHALL BE AT LEAST 75' OR COMPENSATED FOR USING TABLE 5.2.
- THE ENTIRE VEGETATIVE DISCONNECTION SHALL BE ON AN AVERAGE SLOPE OF 5% OR LESS OR USE A LEVEL SPREADER.
- THE CONTRIBUTING AREA OF ROOFTOP TO EACH DISCONNECT SHALL BE 500 S.F. OR LESS.

#### INSPECTION:

A FINAL INSPECTION SHALL BE CONDUCTED BEFORE USE AND OCCUPANCY APPROVAL TO ENSURE THAT ADEQUATE TREATMENT AREAS AND PERMANENT STABILIZATION HAS BEEN ESTABLISHED.

#### MAINTENANCE CRITERIA:

MAINTENANCE OF AREAS RECEIVING DISCONNECTED RUNOFF IS GENERALLY NO DIFFERENT THAN THAT REQUIRED FOR OTHER LAWN OR LANDSCAPED AREAS. THE AREAS RECEIVING RUNOFF SHOULD BE PROTECTED FROM FUTURE COMPACTION (E.G., BY PLANTING TREES OR SHRUBS ALONG THE PERIMETER). IN COMMERCIAL AREAS, HIGH FOOT TRAFFIC SHOULD BE DISCOURAGED AS WELL.

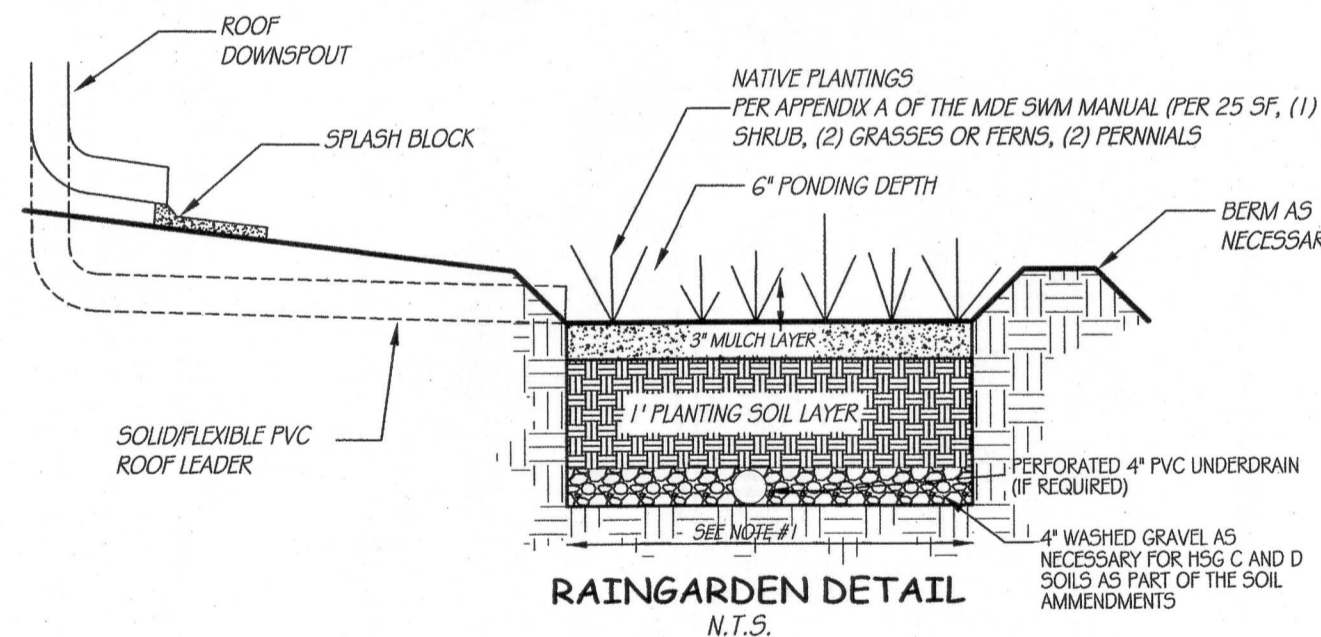

### PLANTING RECOMMENDATIONS

RAINGARDEN # 1 (203 SF)  
(9) SHRUBS, (18) GRASSES OR FERNS, (18) PERENNIALS

RAINGARDEN # 2 (119 SF)  
(5) SHRUBS, (10) GRASSES OR FERNS, (10) PERENNIALS


#### RECOMMENDED SPECIES:

PERENNIALS	GRASSES	PERENNIALS	SHRUBS
CINNAMON FERN (OSMUNDA CINNAMOMEA)	THREE-SQUARE BULRUSH (SCIRPUS PUNGENS)	CARDINAL FLOWER (LOBELIA CARDINALIS)	HIGHBUSH BLUEBERRY (VACCINIUM CORYMBOSUM)
SENSITIVE FERN (ONOCLEA SENSIBILIS)	BENT SEDGE (CAREX STYLOFLORA)	GOLDEN-ROD (SOLIDAGO AUSTRINA)	INKBERRY (ALEX GLABRA)
	SWITCHGRASS (PANICUM VIRGATUM)	NEW ENGLAND ASTER (ASTER NOVAE-ANGLIAE)	SPICEBUSH (LINDERA BENZOIN)
	VIRGINIA WILD RYE (ELYMUS VIRGINICUS)	JOE-PYE WEED (EUPATORIUM FISTULOSUM)	BUTTONBUSH (CEPHALANTHUS OCCIDENTALIS)
			SWAMP ROSE (ROSA PALUSTRIS)
			SWAMP AZALEA (RHODODENDRON VISCOSUM)



PROFESSIONAL CERTIFICATION  
I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND, LICENSE NO. 13310, EXPIRATION DATE: 1-30-25

*James Christopher Lorenzi*  
DATE 3/2/23

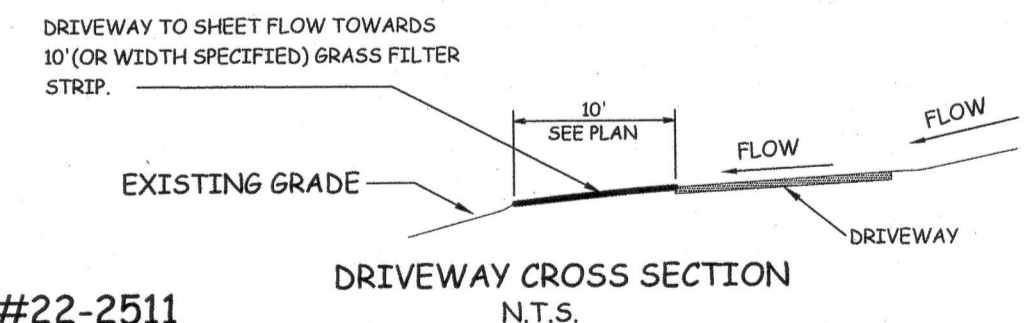

SFDD#22-2511









#### REVISIONS

<b>Waldorf Lions Foundation, Inc</b> Golden Beach - Section 2 - Lot 681 L. 6020 F. 280 5TH ELECTION DISTRICT ~ ST. MARY'S COUNTY, MARYLAND		SCALE: NONE
STORM WATER MANAGEMENT DETAILS AND NOTES		
DRAWN: NOVEMBER, 2022 NJ	CONTRACT REFERENCE 229020	2 OF 4
LORENZI, DODDS, AND GUNNILL, INC. 3475 LEONARDTOWN ROAD, SUITE 100 WALDORF, MARYLAND 20602 PH: (301) 645-2254 or (301) 843-6255		

**SOIL AMENDMENT NOTE:**  
SWM DISCONNECT AREAS IN HSG C SOILS MAY REQUIRE SOIL AMENDMENTS. SCARIFY THE SURFACE OR ROTOTILL THE SOIL OF THE DISCONNECT PATH OR FILTER STRIP TO A DEPTH OF 4-6" AND PROVIDE GROUND COVER TO ENSURE PERMEABILITY.

Material	Specification	Size	Notes
Plantings	see Appendix A, Table A.4	n/a	plantings are site-specific
Planting soil [2" to 4" deep]	loamy sand (80 - 65%) & compost (33 - 40%) or sandy loam (30%), coarse sand (30%) & compost (40%)	n/a	USDA soil types loamy sand or sandy loam; clay content < 5%
Organic content	Min. 10% by dry weight (ASTM D 2974)		
Mulch	shredded hardwood		aged 6 months, minimum; no pine or wood chips
Pea gravel diaphragm	pea gravel: ASTM-D-448	NO. 8 OR NO. 9 (1/8" TO 3/8")	
Curtain drain	ornamental stone: washed cobbles	stone: 2" to 5"	
Geotextile		n/a	PE Type 1 nonwoven
Gravel (underdrains and infiltration basins)	AASHTO M-43	NO. 57 OR NO. 6 AGGREGATE (3/8" to 3/4")	
Underdrain piping	F 758, Type PE 28 or AASHTO M-278	4" to 6" rigid schedule 40 PVC or SDR35	Slotted or perforated pipe; 3/8" perf. @ 6" on center, 4 holes per row; minimum of 3" of gravel over pipes; not necessary underneath pipes. Perforated pipe shall be wrapped with 1/4-inch galvanized hardware cloth
Poured in place concrete (if required)	MSHA Mix No. 3; F <sub>c</sub> = 3500 psi @ 28 days, normal weight, air-entrained; reinforcing to meet ASTM-615-90	n/a	on-site testing of poured-in-place concrete required: 28 day strength and slump test; all concrete design (cast-in-place or pre-cast) not using previously approved State or local standards requires design drawings sealed and approved by a professional structural engineer licensed in the State of Maryland - design to include meeting ACI Code 350 R-28; vertical loading [5]-10 or H-20; allowable horizontal loading (based on soil pressures); and analysis of potential cracking
Sand	AASHTO-M-6 or ASTM-C-33	0.02" to 0.04"	Sand substitutions such as Diabase and Graystone (AASHTO) #16 are not acceptable. No calcium carbonated or dolomitic sand substitutions are acceptable. No "rock dust" can be used for sand.

# SEDIMENT AND EROSION CONTROL NOTES AND DETAILS

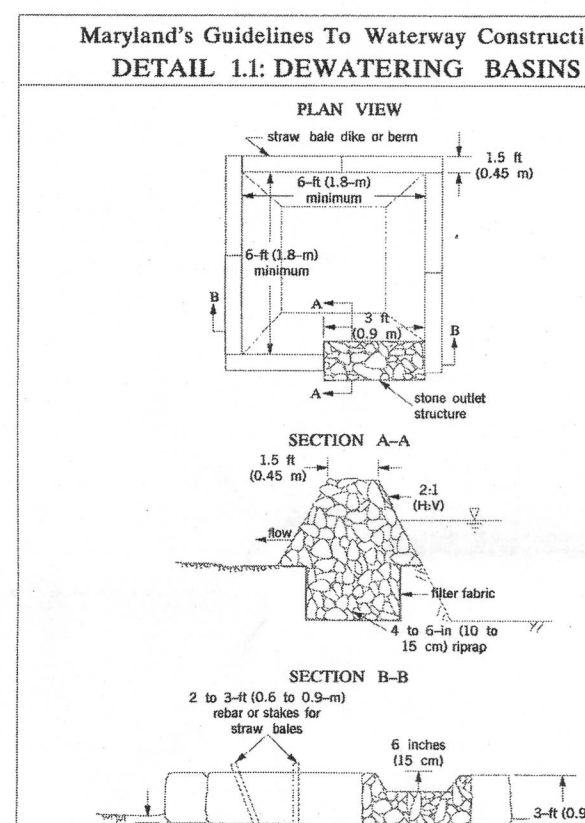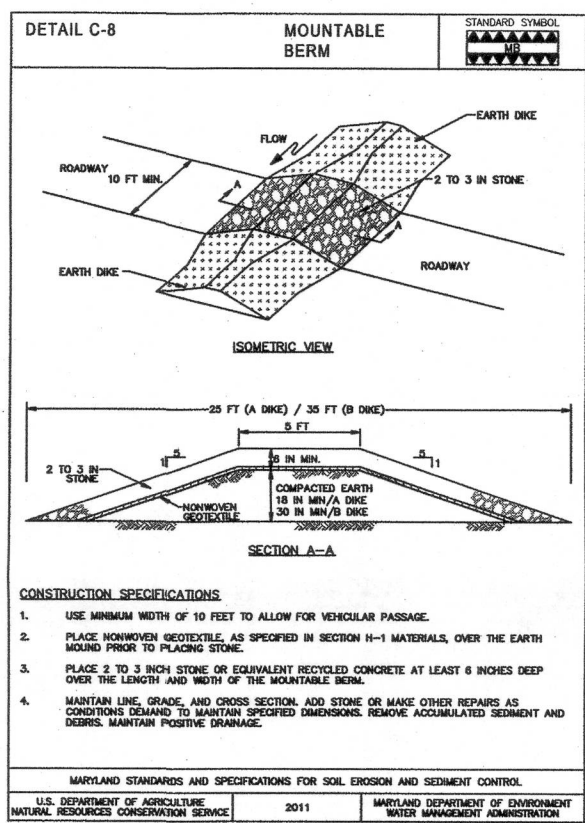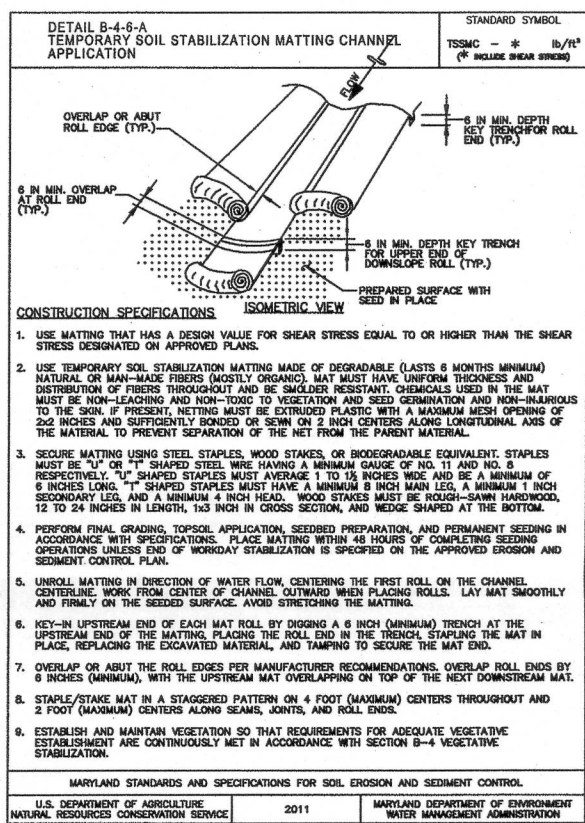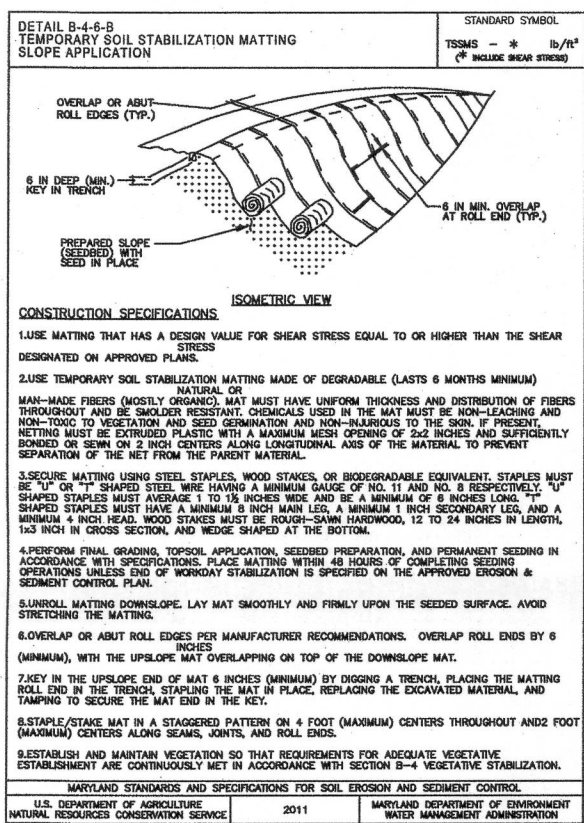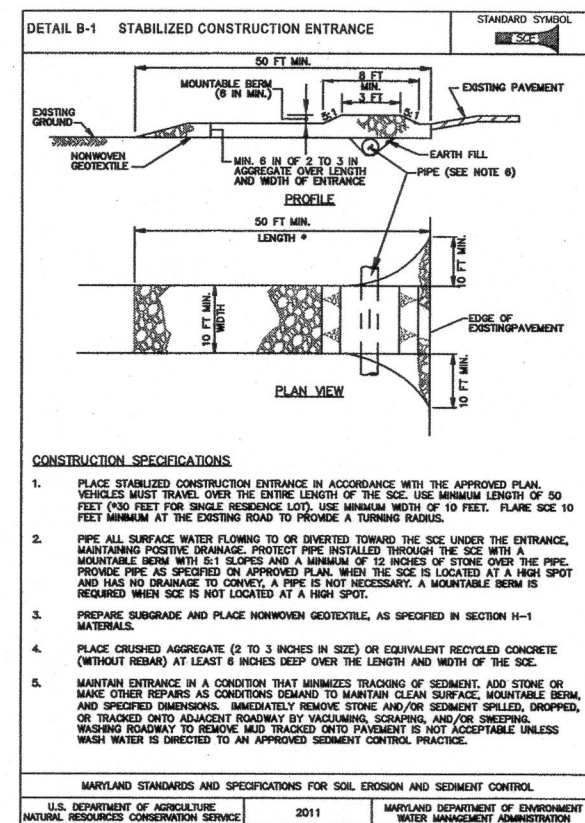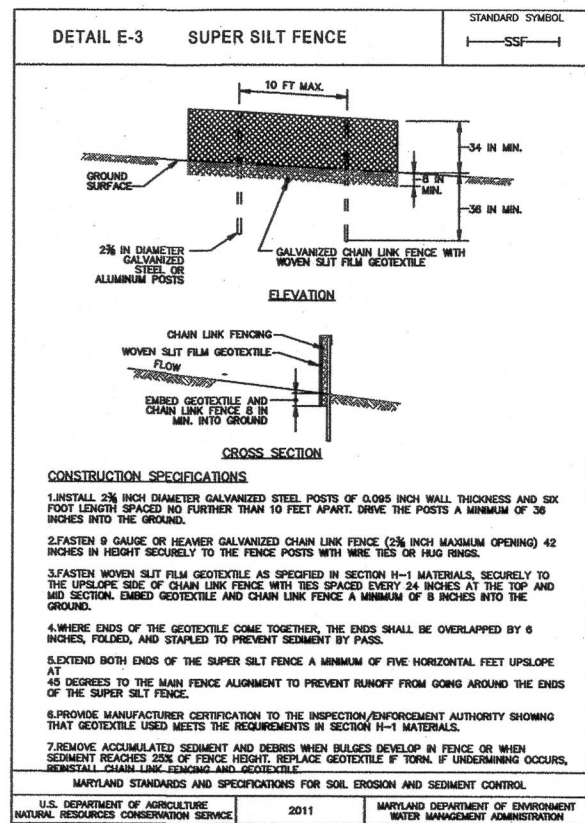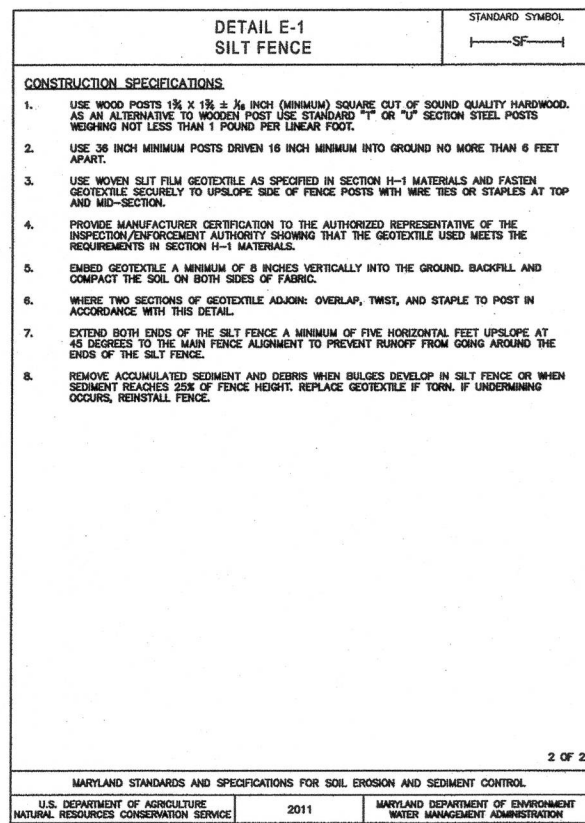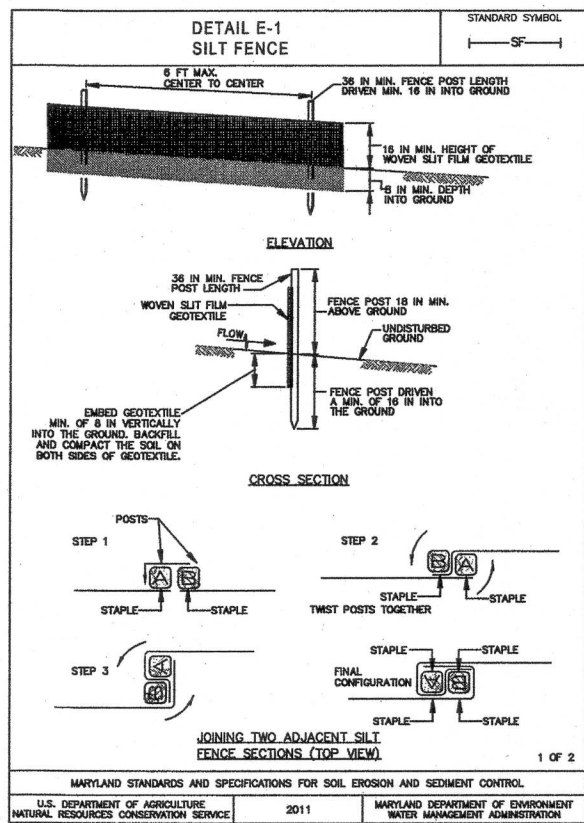

## SEQUENCE OF CONSTRUCTION

STANDARD STABILIZATION NOTE: FOLLOWING INITIAL SOIL DISTURBANCE OR RE-DISTURBANCE, SEEDING FOR PERMANENT OR TEMPORARY STABILIZATION SHALL BE COMPLETED WITHIN THREE (3) CALENDAR DAYS AS TO THE SURFACE OF ALL PERIMETER CONTROLS, DIKES, SWALES, DITCHES, PERIMETER SLOPES, AND ALL SLOPES GREATER THAN 3 HORIZONTAL TO 1 VERTICAL (3:1); AND SEVEN (7) CALENDAR DAYS AS TO ALL OTHER DISTURBED OR GRADED AREAS ON THE PROJECT SITE NOT UNDER ACTIVE GRADING. ONCE VEGETATION IS ESTABLISHED, THE SITE SHALL HAVE 95% GROUND COVER TO BE CONSIDERED ADEQUATELY STABILIZED.

EACH EROSION AND SEDIMENT CONTROL PLAN SHOULD BE INDEPENDENT OF ANY OTHER APPROVED PLAN AND SHOULD "STAND ON ITS OWN" FROM BEGINNING TO THE END OF CONSTRUCTION.

ANY OTHER APPROVED SEDIMENT AND EROSION CONTROL PLAN WITH A SEQUENCE AND/OR PRACTICES WHICH CONFLICT WITH THIS PLAN, WILL REQUIRE PLAN REVISIONS FOR ALL AFFECTED PLANS APPROVED BY THE ST. MARY'S SOIL CONSERVATION DISTRICT.

PHASE CLEARING AND GRADING SHOULD BE USED WHENEVER STEEP SLOPES AND/OR STREAMS OR OTHER SENSITIVE AREAS OR WHEN MASS GRADING IS PROPOSED.

SEDIMENT AND EROSION CONTROLS CANNOT BE REMOVED UNTIL THE SITE HAS ADEQUATE STABILIZATION. ONCE VEGETATION IS ESTABLISHED, THE SITE SHALL HAVE 95% GROUND COVER TO BE CONSIDERED ADEQUATELY STABILIZED AND THE SEDIMENT CONTROL INSPECTOR HAS APPROVED SUCH REMOVAL.

SITE MUST BE GRADED IN SUCH A MANNER THAT THE APPROVED DRAINAGE DIVIDES ARE MAINTAINED THROUGHOUT SITE CONSTRUCTION.

## INSPECTION AGENCY APPROVAL STATEMENTS

- APPROVAL OF THE INSPECTION AGENCY SHALL BE REQUESTED UPON COMPLETION FOR INSTALLATION OF PERIMETER EROSION AND SEDIMENT CONTROLS, BUT BEFORE PROCEEDING WITH ANY OTHER EARTH DISTURBANCE.
- APPROVAL SHALL BE REQUESTED UPON FINAL STABILIZATION OF ALL SITES BEFORE REMOVAL OF SEDIMENT CONTROLS.
- THE CONTRACTOR SHALL NOTIFY MDE, ENFORCEMENT DIVISION ONCE THE PERIMETER SEDIMENT CONTROLS HAVE BEEN INSTALLED AT 410-537-3510 OR MDE, SEDIMENT AND STORMWATER ADMINISTRATION, 1800 WASHINGTON BLD., BALTIMORE, MD. 21238-1708.

## SEQUENCE OF CONSTRUCTION

- THE CONTRACTOR/DEVELOPER MUST NOTIFY ST. MARY'S SOIL CONSERVATION DISTRICT AT 301-475-8402 EXT. 3 TO SCHEDULE A PRE-CONSTRUCTION MEETING AND MISS UTILITY AT 1-800-257-7777 AT LEAST 5 DAYS PRIOR TO BEGINNING CONSTRUCTION AND AT LEAST 5 DAYS PRIOR TO RESTARTING CONSTRUCTION IF ACTIVITY HAS STOPPED FOR MORE THAN TEN DAYS. APPROVAL OF THE INSPECTION AGENCY (MARYLAND DEPARTMENT OF THE ENVIRONMENT AT (410) 537-3510) SHALL BE OBTAINED BY THE OWNER/DEVELOPER UPON COMPLETION OF THE INSTALLATION OF PERMANENT SEDIMENT CONTROLS, BUT PRIOR TO ANY OTHER EARTH DISTURBANCE OR GRADING.
  - CONTRACTOR/DEVELOPER SHALL ARRANGE FOR STAKEOUT OF LIMITS OF DISTURBANCE (LOD) AND PERIMETER SEDIMENT CONTROL DEVICES. IF APPLICABLE, FOREST CONSERVATION SIGNAGE, TREE PROTECTION DEVICES, BLUE PAINT MARKS, AND/OR FLAGGING SHALL BE INSTALLED AT THIS TIME. TEMPORARILY STABILIZE AS INDICATED ON APPROVED PLAN. 5 DAYS
  - THE CONTRACTOR SHALL NOTIFY MDE, ENFORCEMENT DIVISION, AT LEAST 48 HOURS PRIOR TO COMMENCING CLEARING OR GRADING AT: 410-537-3510 OR MDE, SEDIMENT AND STORMWATER ADMIN., 1800 WASHINGTON BLVD., BALTIMORE, MD 21238-1708. AS NEEDED. 5 DAYS
  - UPON APPROVAL OF THE MDE INSPECTOR, CLEAR THE REMAINING AREA TO BE DISTURBED. CONTRACTOR SHALL MONITOR TREE PROTECTION DURING CONSTRUCTION. 5 DAYS
  - PERMANENTLY STABILIZE THE ENTIRE DISTURBED AREA(S) WITH MINIMUM 4 INCHES OF TOPSOIL, SEED, AND MULCH. CONTRACTOR SHALL PROVIDE QUALITY LANDSCAPING TOPSOIL AND CONFORM TO B-4.2 OF THE 2011 STANDARDS AND SPECS. FOR SEDIMENT AND EROSION CONTROL. 2 DAYS
  - ONCE CONTRIBUTING DRAINAGE AREA IS ADEQUATELY STABILIZED, INSTALL STORM WATER MANAGEMENT FACILITIES, AND CRITICAL AREA PLANTINGS AND FINALE DRIVEWAY SURFACE TREATMENT (ASPHALT, CR-6 OR CONCRETE) AS SPECIFIED ON PLAN. PERMANENTLY STABILIZE ANY REMAINING DISTURBED AREAS THAT SAME DAY. 3 DAYS
  - APPROVAL BY THE MDE INSPECTOR SHALL BE OBTAINED BY THE OWNER/DEVELOPER UPON ADEQUATE STABILIZATION OF THE SITE WITH 95% VEGETATIVE GROUND COVER OF THE SITE, BUT BEFORE REMOVAL OF THE SEDIMENT CONTROLS. PERMANENTLY STABILIZE ANY REMAINING DISTURBED AREAS THAT SAME DAY. 1 DAY
  - IF REQUIRED, CONTRACTOR/DEVELOPER SHALL ARRANGE POST CONSTRUCTION FOREST CONSERVATION INSPECTION WITH A ST. MARY'S COUNTY FOREST INSPECTOR PRIOR TO USE AND OCCUPANCY.
- TOTAL TIME APPROXIMATELY 3 MONTHS

## ST. MARY'S SOIL CONSERVATION DISTRICT DETAILS AND SPECIFICATIONS FOR VEGETATIVE ESTABLISHMENT

Standard Stabilization Note: Following initial soil disturbance or re-disturbance, seeding for permanent or temporary stabilization shall be completed within:

- Three (3) calendar days as to the surface of all perimeter controls, dikes, swales, ditches, perimeter slopes, and all slopes greater than 3 horizontal to 1 vertical (3:1); and
- Seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.

Once vegetation is established, the site shall have 95% groundcover to be considered adequately stabilized.

### 1. Permanent Seeding:

- Soil Tests: Lime and fertilizer will be applied per soil test results for sites greater than 5 acres. Soil tests will be done at completion of initial rough grading or as recommended by the sediment control inspector. Rates and analyses will be provided to the grading inspector as well as the contractor. The minimum soil conditions required for permanent vegetative establishment are:
  - Soil pH shall be between 6.0 and 7.0.
  - Soluble salts shall be less than 500 parts per million (ppm).
  - The soil shall contain less than 40% clay but enough fine grained material (>30% silt plus clay) to provide the capacity to hold a moderate amount of moisture. An exception is if loess or serecia lespedeza is to be planted, then a sandy soil (<30% silt plus clay) would be acceptable.
  - Soil shall contain 1.3% minimum organic matter by weight.
  - Soil must contain sufficient pore space to permit adequate root penetration.
  - If these conditions cannot be met by soils on site, adding topsoil is required in accordance with Section B-4.2 titled Standards and Specifications for Soil Preparation, Topsoil, and Soil Amendments as found in the 2011 Maryland Standards and Specifications for Erosion and Sediment Control.

- Seedbed Preparation: Area to be seeded shall be loose and friable to a depth of at least 3 to 5 inches. The top layer shall be loosened by raking, disking or other acceptable means before seeding occurs. For sites less than 5 acres, apply 100 pounds dolomitic limestone, hydrated or burnt lime may be substituted except when hydro seeding, and 10 pounds of 10-20-20 fertilizer per 1,000 square feet. Harrow or disk lime and fertilizer into the soil to a depth of at least 3 to 5 inches on slopes flatter than 3:1.

- Seeding: Apply 5-lb per 1,000 square feet of tall fescue between February 15 and April 30 or between August 15 and October 31. Apply seed uniformly on a moist firm seedbed with a cyclone seeder, cultipacker seeder or hydroseeder (slurry includes seeds and fertilizer, recommended on steep slopes only). Maximum seed depth should be 1/4 inch in clayey soils and 1/2 inch in sandy soils when using other than the hydroseeder method. Irrigate where necessary to support adequate growth until vegetation is firmly established. If other seed mixes are to be used, said selections must meet the 2011 Standards and Specifications for Soil Erosion and Sediment Control.

- Mulching: Mulch shall be applied to all seeded areas immediately after seeding as per Section B-4.3 entitled Standards and Specifications for Seeding and Mulching as found in the 2011 Standards and Specifications for Soil Erosion and Sediment Control. During the time periods when seeding is not permitted, mulch shall be applied immediately after grading and maintained until seeding can be performed.

- Mulch shall be unrotted, unchopped, small grain straw applied at a rate of 2 tons per acre or 90 pounds per 1,000 square feet (2 bales). If a mulch-anchoring tool is used, apply 2.5 tons per acre. Mulch materials shall be relatively free of all kinds of weeds and shall be completely free of prohibited noxious weeds. Spread mulch uniformly, mechanically or by hand, to a depth of 1-2 inches.

- Securing Straw Mulch: Straw mulch shall be secured immediately following mulch application to minimize movement by wind or water. The following methods are permitted:

- Use a mulch-anchoring tool which is designed to punch and anchor mulch into the soil surface to a minimum depth of 2 inches. This is the most effective method for securing mulch, however, it is limited to relatively flat areas where equipment can operate safely. If a mulch-anchoring tool is used, apply 2.5 tons per acre.
- Wood cellulose fiber may be used for anchoring straw. Apply the fiber binder at a net dry weight of 750 pounds per acre. If mixed with water, use 50 pounds of wood cellulose fiber per 100 gallons of water.
- Liquid binders may be used. Apply at higher rates at the edges where wind catches mulch, such as in valleys and on crests of slopes. The remainder of the area should appear uniform after binder application. Refer to the 2011 Standards and Specifications for Soil Erosion and Sediment Control or approved equal shall be applied at rates recommended by the manufacturers.
- Lightweight plastic netting may be used to secure mulch. The netting will be stapled to the ground according to manufacturer's recommendations.

- Irrigation: In the absence of adequate rainfall, irrigation should be performed to ensure adequate vegetative establishment.

- Line: 100 pounds of dolomitic limestone per 1,000 square feet.  
Fertilizer: 10 pounds of 10-20-20 per 1,000 square feet.  
Seed: Annual Ryegrass - 1.00 pounds per 1,000 square feet (February 15 through April 30 or August 15 through November 30).

- Millet - 1.00 pounds per 1,000 square feet (May 1 through August 15).

- Mulch: Same as 1 D and E above.

- No fill may be placed on frozen ground. All fill to be placed in approximately horizontal layers, each layer having a loose thickness of not more than 8 inches. All fill in roadways and parking areas are to be classified as per Charles County requirements. Any fill within the building area is to be compacted to a minimum of 95% density. Fills for pond embankments shall be compacted as per MD-378 Construction Specifications. All other fills shall be compacted sufficiently so as to be stable and prevent erosion and slippage.

- Permanent Sod: Installation of sod should follow permanent seeding dates. Seedbed preparation for sod shall be as noted in section (B) above. Permanent sod is to be tall fescue, state approved sod; lime and fertilizer per permanent seeding specifications and lightly irrigate soil prior to laying sod. Sod is to be laid on the contour with all ends tightly abutting. Joints are to be staggered between rows. Water and roll or tamp sod to insure positive root contact with the soil. All slopes steeper than 3:1, as shown, are to be permanently sodded or protected with an approved erosion control netting. Additional watering for establishment may be required. Sod is not to be installed on frozen ground. Sod shall not be transplanted when moisture content (dry or wet) and/or extreme temperature may adversely affect its survival. In the absence of adequate rainfall, irrigation should be performed to ensure establishment of sod.

- Mining Operations: Sediment control plans for mining operations must include the following seeding dates and mixtures: For seeding dates of February 1 through April 30 and August 15 through October 31, use seed mixture of tall fescue at the rate of 2 pounds per 1,000 square feet and sericea lespedeza at the minimum rate of 0.5 pounds per 1,000 square feet.

- Topsoil shall be applied as per the Standard and Specifications for Topsoil from the current 2011 Maryland Standards and Specifications for Soil Erosion and Sediment Control.

NOTE: Use of this information does not preclude meeting all of the requirements of the 2011 Maryland Standards and Specifications for Soil Erosion and Sediment Control.

REVISION NUMBER	CONSTRUCTION REVISION	REVISION DATE

FOR HIGHLY ERODABLE SOILS: STABILIZE ALL DISTURBED AREAS WITH EROSION CONTROL MATTING.

PROVIDE 8" OF TOPSOIL COMPACTED TO 4" OVER DIST. AREAS TO FACILITATE GRASS GROWTH.

WATER SEED AND MULCH AS NECESSARY TO PROVIDE FOR ACCELERATED GROWTH

### STOCKPILE NOTE

IF NO STOCKPILE IS SHOWN ON PLAN VIEW, THEN ALL EXCESS MATERIAL WILL BE IMMEDIATELY TAKEN TO A SITE WITH AN APPROVED AND ACTIVE SEDIMENT AND EROSION CONTROL PLAN. CONTRACTOR MUST INFORM SEDIMENT AND EROSION CONTROL INSPECTOR AS TO THE NAME AND PLAN REFERENCE NUMBER OF SAID PLAN.

TOTAL SITE AREA = 0.34 AC.  
TOTAL STABILIZED AREA = 0.18 AC.  
TOTAL DISTURBED AREA = 0.25 AC.  
VOL. OF EXCAVATION = 60 C.Y.  
(ALL MATERIAL TO REMAIN ON SITE)  
VOL. OF SPOIL = 60 C.Y.  
VOL. OF BORROW = 0.0 C.Y.

### TEMPORARY SEEDING SUMMARY

HARDINESS ZONE (FROM FIGURE B.3): ZONE 7a				SEED MIXTURE (FROM TABLE B.1):		FERTILIZER RATE (10-20-20)	LIME RATE
NO.	SPECIES	APPLICATION RATE (LB/AC)	SEEDING DATES	SEEDING DEPTHS			
	ANNUAL RYEGRASS	40	Feb. 15 - April 30 Aug. 15 - Nov. 30	0.5 in.		436 LB/AC (10 LB/1000 SF)	2.5 TONS/AC (100 LB/1000 SF)

COMPLETE THE CHART AS PER THE 2011 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL IF USING ALTERNATIVES TO THE STANDARD NOTES (THIS SHEET).

### PERMANENT SEEDING SUMMARY

HARDINESS ZONE (FROM FIGURE B.3): ZONE 7a				SEED MIXTURE (FROM TABLE B.3):		FERTILIZER RATE (10-20-20)		LIME RATE
NO.	SPECIES	APPLICATION RATE (LB/AC)	SEEDING DATES	SEEDING DEPTHS	N	P2O5	K2O	
	KENTUCKY BLUEGRASS	15	March 1 - May 15 Aug. 15 - Oct. 30	1/4" - 1/2"	45 LB/AC (1.0 LB/1000 SF)	90 LB/AC (2 LB/1000 SF)	90 LB/AC (2 LB/1000 SF)	2.5 TONS/AC (100 LB/1000 SF)

COMPLETE THE CHART AS PER THE 2011 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL IF USING ALTERNATIVES TO THE STANDARD NOTES (THIS SHEET).

CALL "MISS UTILITY" AT 1-800-257-7777 48 Hours Before Start of Construction



PROFESSIONAL CERTIFICATION  
I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND, LICENSE NO. 13310, EXPIRATION DATE: 1-30-25

NAME: *[Signature]* DATE: 3/2/23

SFDD#22-2511



REVISIONS	<b>Waldorf Lions Foundation, Inc</b> Golden Beach - Section 2 - Lot 681 L. 6020 F. 280 5TH ELECTION DISTRICT ~ ST. MARY'S COUNTY, MARYLAND	
	<b>SEDIMENT AND EROSION CONTROL</b> DETAILS AND NOTES	SCALE: NONE
DRAWN: NOVEMBER, 2022 NJ	CONTRACT REFERENCE 229020	
LORENZI, DODDS, AND GUNNILL, INC. 3475 LEONARD TOWN ROAD, SUITE 100 WALDORF, MARYLAND 20602 PH: (301) 645-2254 or (301) 843-6255		3 OF 4

# CRITICAL AREA MITIGATION PLAN, NOTES AND DETAILS

## PROPOSED LOT COVERAGE CALCULATIONS:

STRUCTURE TYPE	MATERIAL	% LOT COVERAGE	SQUARE FOOTAGE	LOT COVERAGE
DRIVEWAY	GRAVEL AND CONC.	5.4 %	809 S.F.	809 S.F.
HOUSE	TYP. COVERED	11.8 %	1,765 S.F.	1,765 S.F.
SIDEWALK	CONC.	0.5 %	74 S.F.	74 S.F.
STOOP	TYP. COVERED	0.2 %	37 S.F.	37 S.F.
TOTAL			2,685 S.F.	2,685 S.F.

PROPOSED LOT COVERAGE: 2,685 S.F. / LOT SIZE (15,000 S.F.) = 17.9%

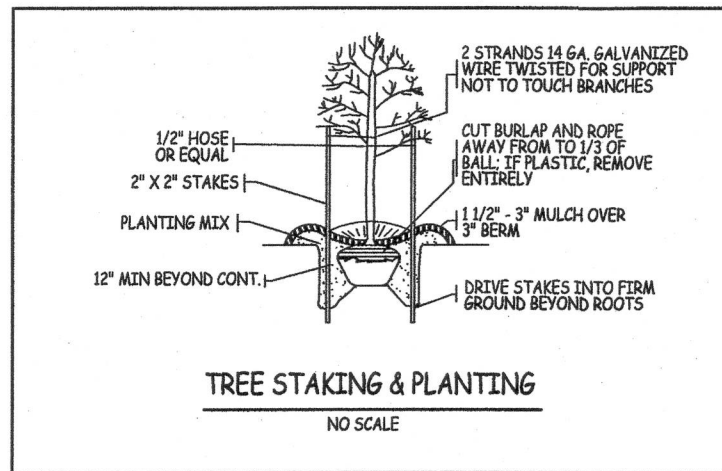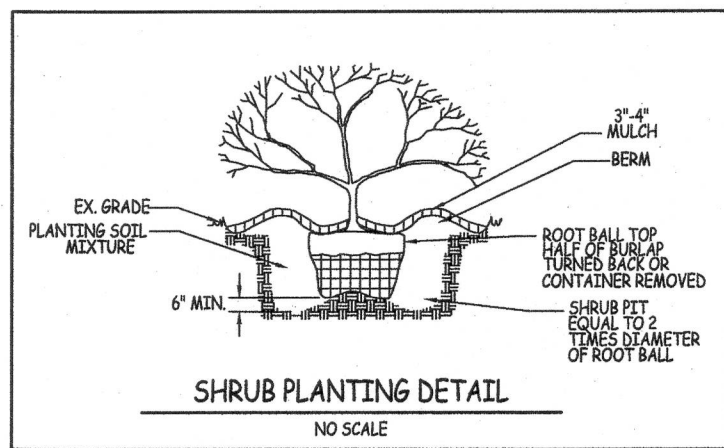

PLANTING CLUSTER SYMBOL	SPECIES NAME AND QUANTITY EA.	COMMON NAME	NO. OF TREES	SIZE	COND.
	1 - LIRIODENDRON TULIPIFERA	TULIP TREE	3	1" DBH.	CONT.
	1 - QUERCUS PHELLOS	WILLOW OAK	4	1" DBH.	CONT.
TOTAL PLANTINGS PROVIDED			7		

1:1 REPLACEMENT OF VEGETATION IS UTILIZED FOR THIS LOT PLEASE REFER TO CRITICAL AREA NOTE #8 ON THIS SHEET

## FOREST COVERAGE CALCULATIONS

- EXISTING FOREST COVERAGE: 11 TREES
- REQUIRED FOREST COVERAGE: PREEXISTING CONDITIONS MUST BE MAINTAINED.
- FOREST AREA DISTURBED: 7 TREES  
THIS LOT REQUIRES REPLACEMENT OF 7 INDIVIDUAL TREES NATIVE PLANT MATERIAL TO BE MITIGATED FOR ON SITE. TOTAL CREDITS PROVIDED: 7 PLANTED TREES. SEE PLANTING PLAN ON THIS SHEET.

## INSPECTION AGREEMENT

I, WALDORF LIONS FOUNDATION INC., THE OWNER OF THE SUBJECT PROPERTY, SHOWN HEREON, DO HEREBY GRANT PERMISSION TO THE APPROVING AUTHORITY TO INSPECT THE PLANTINGS AT THE APPROPRIATE TIMES AT THE ADDRESS PROVIDED BELOW.

*J.M. Agent for W.L.F.* 12/7/22  
WALDORF LIONS FOUNDATION, INC. C/O JAMES CONROY DATE  
(301) 643-2583

## REQUIRED SURVIVAL

AT THE END OF THE TWO YEAR MONITORING PERIOD FOR PLANTED LANDSCAPE STOCK, ALL OF THE PLANTS ARE REQUIRED TO SURVIVE PER COMAR 27.01.09.01-2J. ANY LANDSCAPE STOCK PLANTS THAT DID NOT SURVIVE SHALL BE REPLACED. IF THE COUNTY DETERMINES THAT THE SURVIVAL IS NOT ADEQUATE, THE MONITORING PERIOD MAY BE EXTENDED AND ADDITIONAL INSPECTIONS MAY BE REQUIRED AT THE DISCRETION OF THE COUNTY

SUBSTITUTIONS MUST BE APPROVED BY THE ST. MARY'S COUNTY DEPT. OF LAND USE AND GROWTH MANAGEMENT



## LANDSCAPE NOTES

- ALL PLANT SPECIES SHALL BE NATIVE TO THE CHESAPEAKE BAY WATERSHED AND ATLANTIC COASTAL BAYS REGION BASED ON THE U.S. FISH AND WILDLIFE SERVICE PUBLICATION, NATIVE PLANTS FOR WILDLIFE HABITAT AND CONS. LANDSCAPING.
- SPECIES HAVE BEEN SELECTED BASED ON AN ANALYSIS OF SURROUNDING NATIVE FOREST AND DEVELOPED WOODLAND COVER.
- SHRUB SPECIES DO NOT EXCEED 50% OF THE TOTAL PLANTINGS.
- PLANT MATERIALS SHALL BE PLANTED IN EITHER THE SPRING OR FALL MONTHS. MARCH 15 - MAY 31, SEPT. 15 - NOV. 30
- ALL PLANT MATERIAL SHALL CONFORM TO THE AMERICAN ASSOCIATION OF NURSERYMEN'S PUBLICATION, THE AMERICAN STANDARD NURSERY STOCK.
- HERBACIOUS PLUGS AND TRANSPLANTS SHALL BE KEPT MOIST UNTIL PLANTED SO THAT THE TOP OF THE SOIL ON THE PLUG IS LEVEL WITH THE GROUND

## CRITICAL AREA NOTES

- THIS LOT IS LOCATED WITHIN THE LIMITED DEVELOPMENT AREA (LDA) OF THE CHESAPEAKE BAY CRITICAL AREA.
- THE PURPOSE OF THIS PROJECT IS TO PROVIDE MITIGATION FOR 1:1 REPLACEMENT OF TREES REMOVED FOR THE DEVELOPMENT OF A NEW SINGLE FAMILY HOME PER ST. MARY'S COUNTY ZONING ORDINANCE 72.3.B
- THE MAXIMUM LOT COVERAGE IS 25% FOR A LOT LESS THAN 1/2 ACRE AND CREATED BEFORE DECEMBER 1, 1985. 15,000 S.F. X .25 = 3,750 S.F. (REQUIREMENT MET, SEE LOT COVERAGE CHART BELOW).
- THE PROPOSED LOT COVERAGE IS 2,685 S.F. (17.9%).
- TOTAL LOT AREA: 15,000 S.F. OR 0.34 AC.
- ANY CLEARING THAT TAKES PLACE IN THE CRITICAL AREA WILL BE SUBJECT TO ST. MARY'S COUNTY CRITICAL AREA REGULATIONS.
- ALL REMAINING FORESTED AREAS SHALL REMAIN UNDISTURBED UNLESS OTHERWISE PERMITTED.
- 7 CANOPY TREES ARE PROPOSED TO BE CLEARED. THIS LOT REQUIRES 1:1 REPLACEMENT OF INDIVIDUAL TREES CLEARED. SEE CRITICAL AREA MITIGATION PLAN.
- THIS LOT REQUIRES A MINIMUM OF 15% FOREST COVERAGE POST DEVELOPMENT. REQUIREMENTS MET THROUGH:
  - REQUIREMENT = 15,000 x 15% = 2,250 S.F.
  - PROVIDED = 7 x 400 s.f. = 2,800 s.f.

SFDD#22-2511

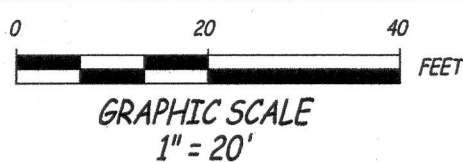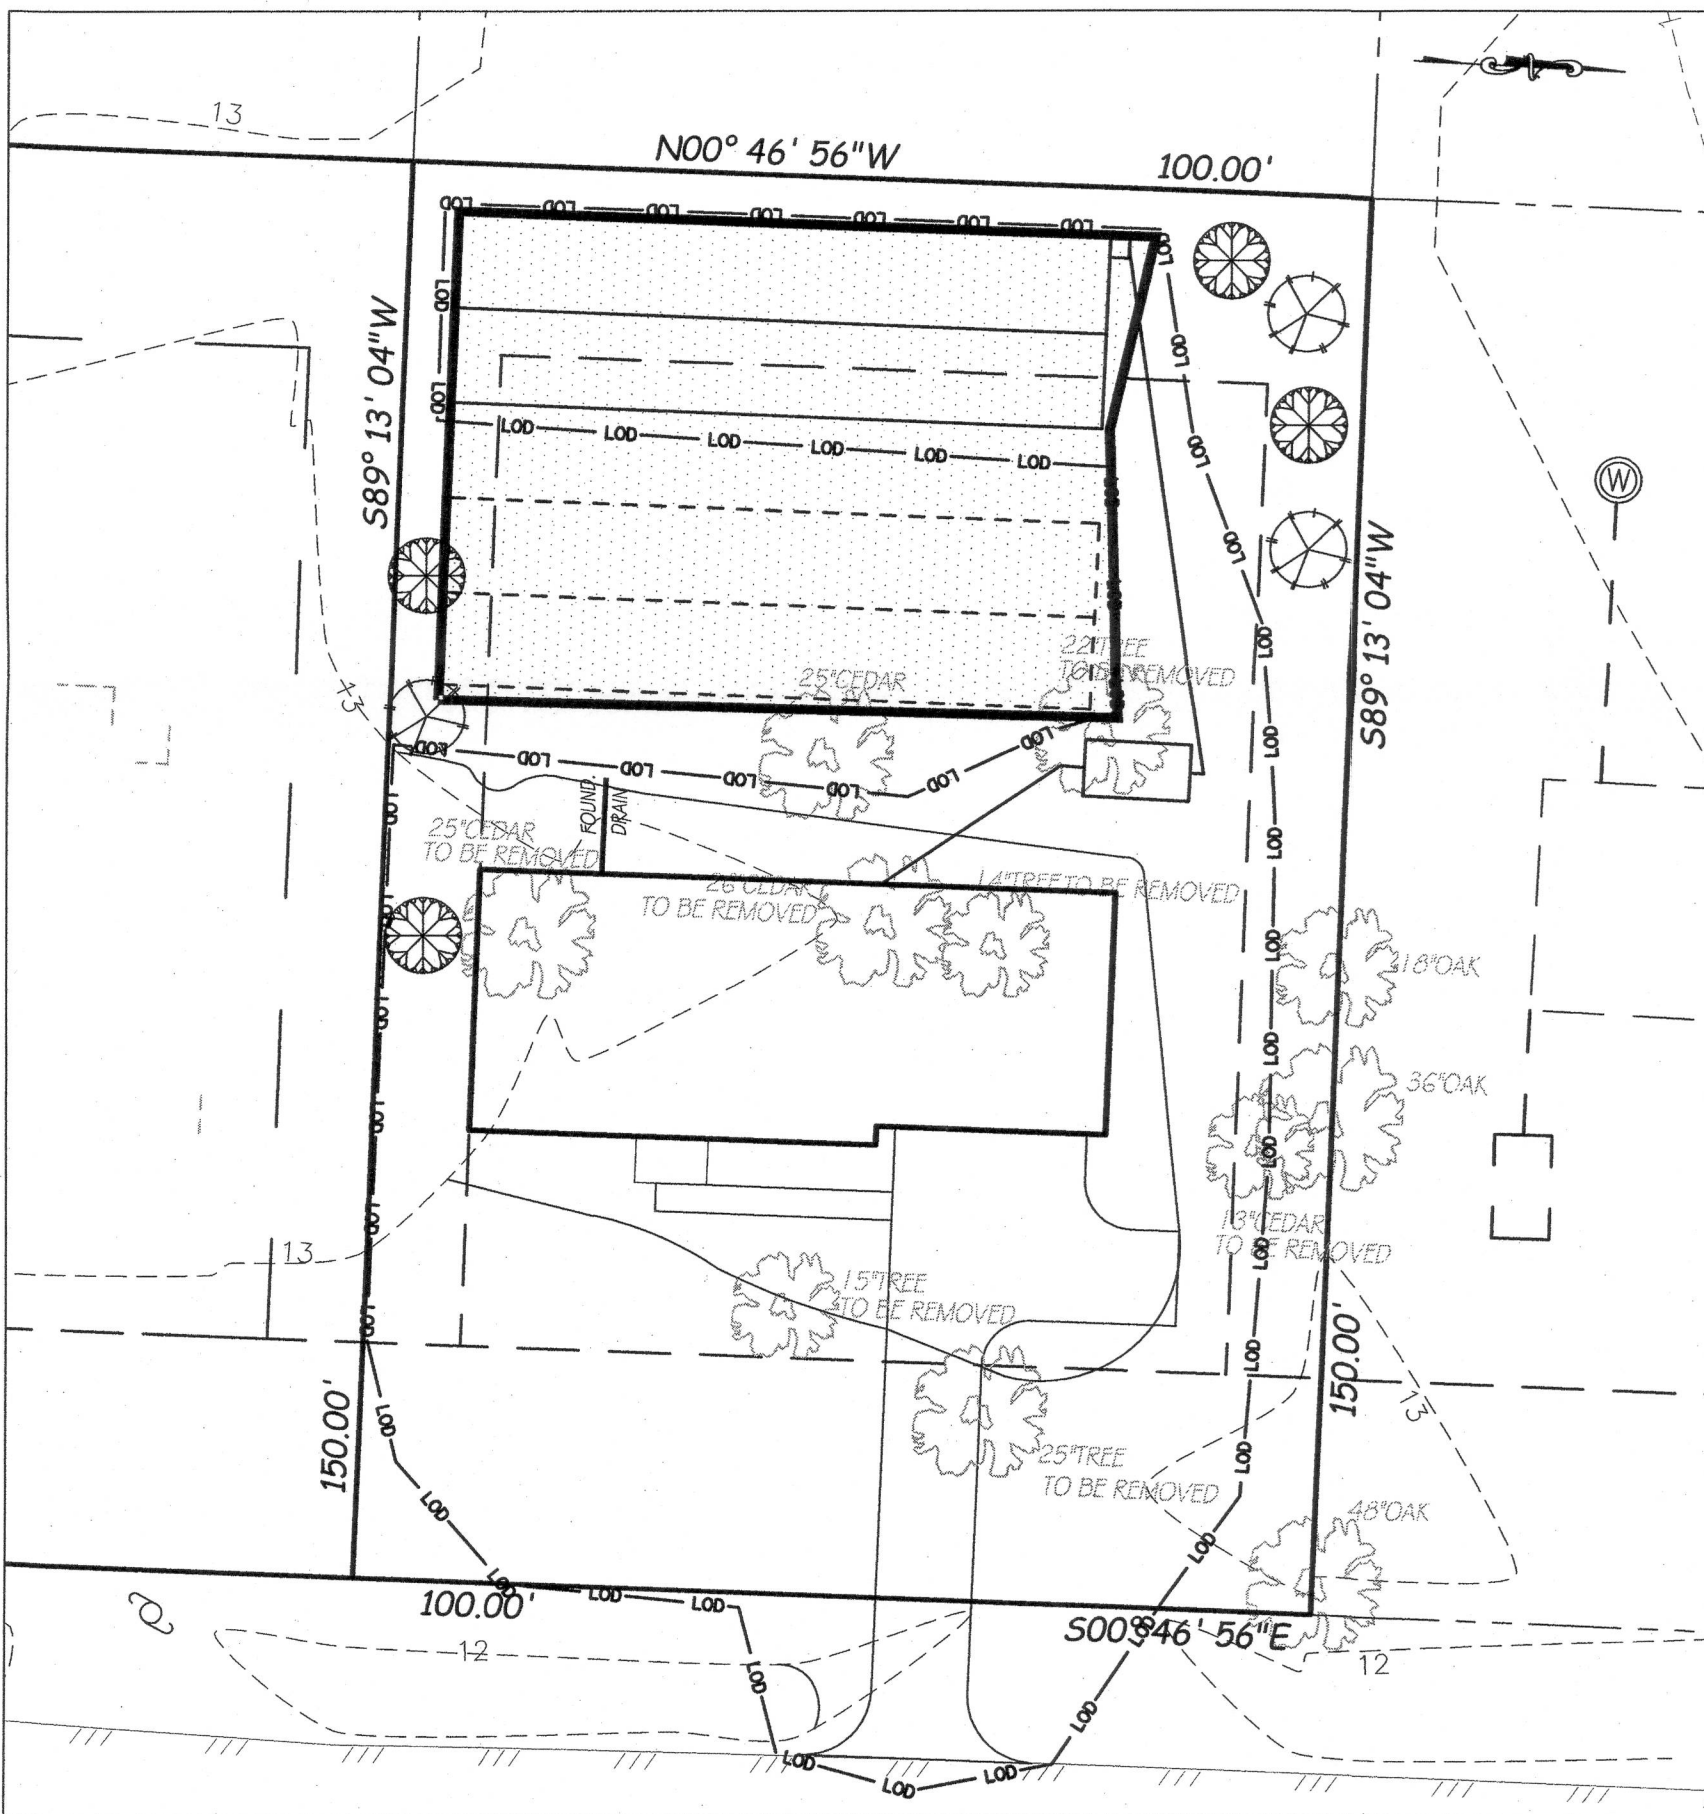

## PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND, LICENSE NO. 13310, EXPIRATION DATE: 1-30-25

*James Christopher Lozano*  
NAME DATE 3/2/23

REVISIONS	
<b>Waldorf Lions Foundation, Inc</b> Golden Beach - Section 2 - Lot 681 L. 6020 F. 280 5TH ELECTION DISTRICT ~ ST. MARY'S COUNTY, MARYLAND	
CRITICAL AREA MITIGATION PLAN, NOTES AND DETAILS	SCALE: 1" = 20'
DRAWN: NOVEMBER, 2022 NJ	CONTRACT REFERENCE 229020
LORENZI, DODDS, AND GUNNILL, INC. 3475 LEONARD TOWN ROAD, SUITE 100 WALDORF, MARYLAND 20602 PH: (301) 645-2254 or (301) 843-6255	
<b>4</b> OF 4	